

HECKMANN BUILDING PRODUCTS

Division of Mechanical Plastics Corp.


1501 N. 31st Avenue

Melrose Park, IL 60160

800-621-4140 Fax 708-865-2640

www.heckmannanchors.com

#75-KB Pos-I-Tie® KeyBolt Tension Pullout Test

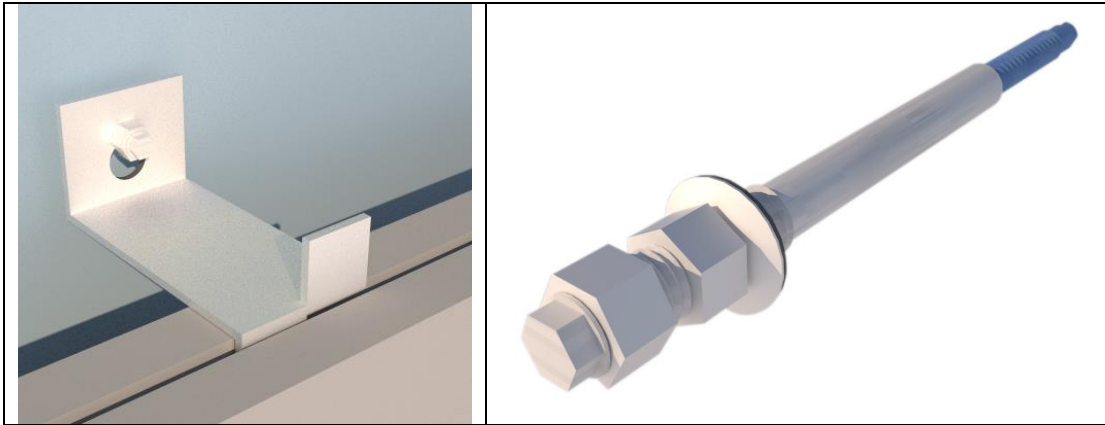

Tests were performed in accordance to ASTM E754.

STAINLESS BARREL SCREW FOR STEEL STUDS

Five Barrel screws were drilled into a 16 gage metal stud. The pullout of the screw from the metal stud was the failure mode in all five cases. The average failure mode was 780 pounds.

Average Tension Failure Load 780 pounds.